


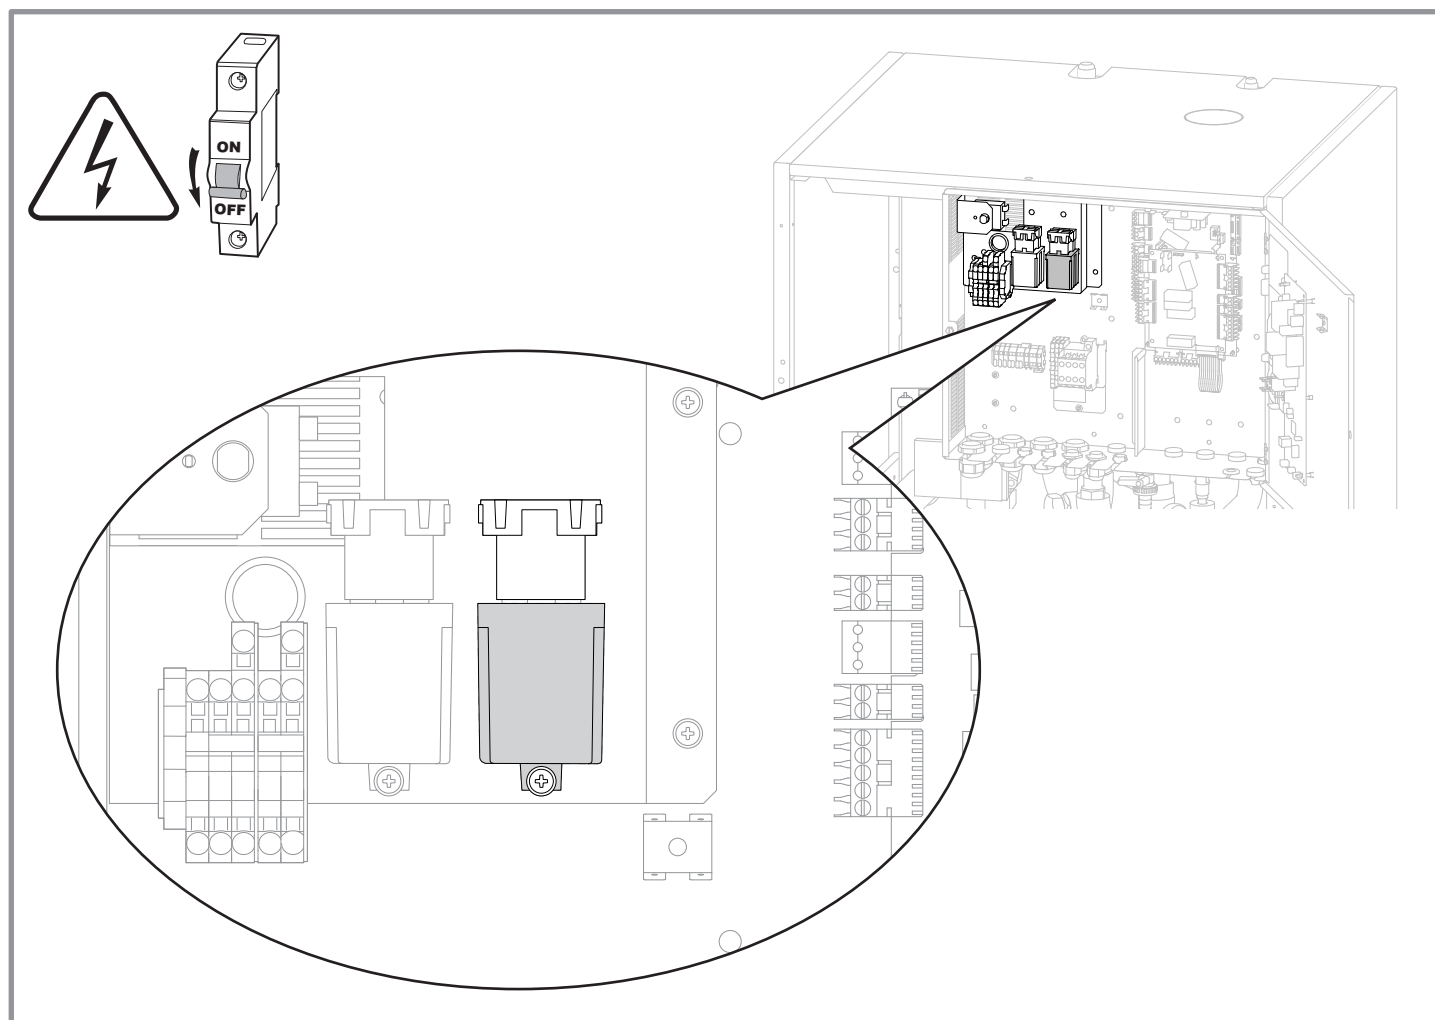

U0587920_1824_EN_2

15/06/2018

Kit Electrical back-up relay

Code 075327

• Power supply to the electrical back-ups

The hydraulic unit contains two stages of electrical back-ups installed in a heat exchange tank.

<i>Heat pump (HP)</i>	<i>Electrical back-ups</i>		<i>Power supply to the electrical back-ups</i>	
<i>Models</i>	<i>Power</i>	<i>Nominal current</i>	<i>Cable connection (phase, neutral, earth)</i>	<i>Curve C circuit breaker size</i>
alfea extensa (duo) A.I. 5, 6, 8 et 10	3 kW	13 A	3 x 1.5 mm ²	16 A
alfea extensa (duo) A.I. 5, 6, 8 et 10 with Kit Electrical back-up relay 6 kW	2 x 3 kW	26.1 A	3 x 6 mm ²	32 A

⚠ Ensure that the general electrical power supply has been cut off before starting any repair work.

